






# T H E   S C S   M E T H O D

Free Air Cooler




Secondary Refrigeration Chiller

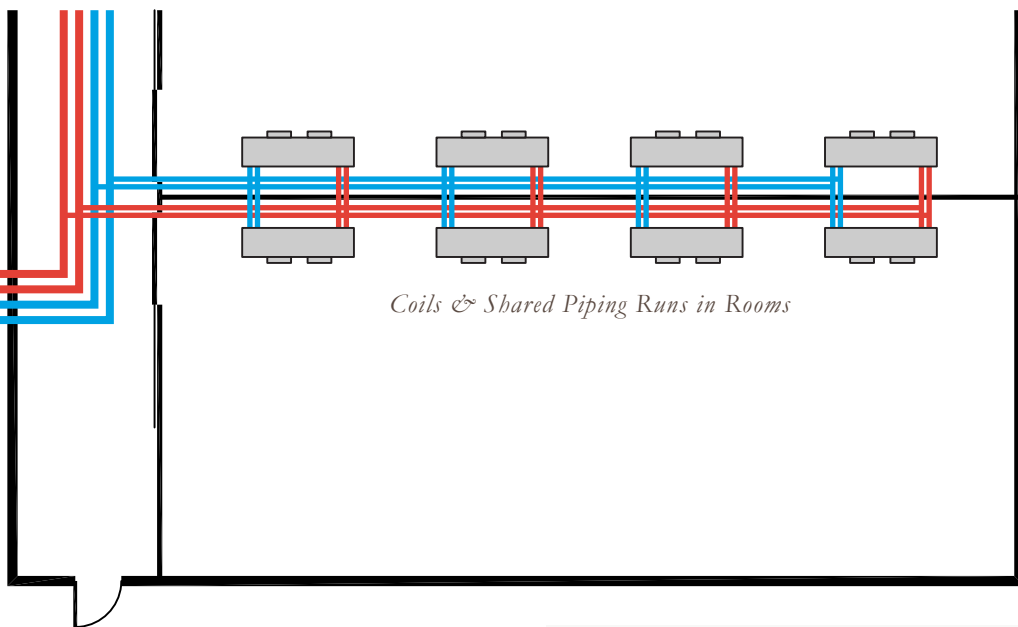


Coils & Shared Piping Runs in Rooms

PLAN VIEW

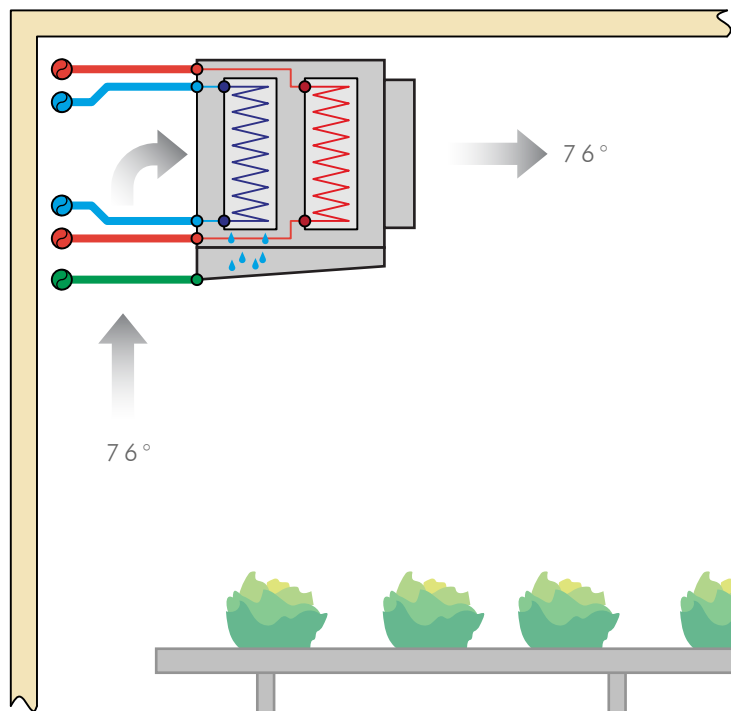

SECTION VIEW

TRADITIONAL RH CONTROL vs SCS REHEAT METHOD

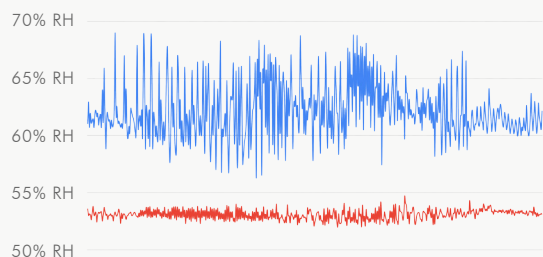

- US Patent No. 11,549,696
- Cooling Coil Creates Condensation
- Room Air Dehumidifies via Condensate Drain
- Warm Coil Reheats Cool Air for Minimal Temperature Change

© 2023 STORAGE CONTROL SYSTEMS, LTD. ALL RIGHTS RESERVED. CONTACT US FOR MORE INFORMATION.



STORAGE CONTROL SYSTEMS, INC  
100 APPLEWOOD DRIVE SPARTA MICHIGAN · SODUS NEW YORK · UNION GAP WASHINGTON  
T 616.887.7994 · F 616.887.1128 · INFO@STORAGECONTROL.COM · STORAGECONTROL.COM



# T H E   S C S   M E T H O D



*Lights Hang Below Coils for Maximum Canopy Height*



*Slim-Line Coil with even Less Vertical Impact*



*Low Profile V-Flow Dual-Discharge Coils use Less Space and Improve Airflow*



*Back-to-Back Coil Arrangement over Aisle in Room*



*Chiller with Free Cooler Option using Outdoor Temperatures for Cooling*

© 2023 STORAGE CONTROL SYSTEMS, LTD. ALL RIGHTS RESERVED. CONTACT US FOR MORE INFORMATION.



STORAGE CONTROL SYSTEMS, INC  
100 APPLEWOOD DRIVE SPARTA MICHIGAN · SODUS NEW YORK · UNION GAP WASHINGTON  
T 616.887.7994 · F 616.887.1128 · INFO@STORAGECONTROL.COM · STORAGECONTROL.COM